


Operating instructions

MTP200ia-TE-SIL MTP200ib-TE-SIL

WINSMART support
MODBUS-RTU communication

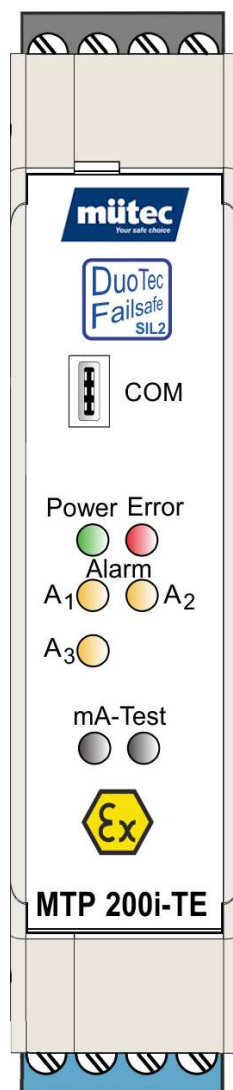

Operating instructions for MTP200ia-TE-SIL, MTP200ib-TE-SIL

WINSMART support from MTP200 version 4.0
MODBUS-RTU communication

Publication no.: BA 125
Date of issue: 1/2024

Manufacturer:

Mütec Instruments GmbH
Bei den Kämpfen 26
21220 Seevetal
Germany

Tel: +49 (0) 4185 8083-0
Fax: +49 (0) 4185 808380

e-mail: info@muetec.de
Internet: www.muetec.de

License, trademark and copyright notices

Modbus™ is a registered trademark of Modicon Inc.
Windows™ is a registered trademark of Microsoft Corp.

Copyright © Mütec Instruments GmbH 2024 All rights reserved

This document is protected by copyright. It supports the user in the safe and efficient use of the device. This document may not be passed on or reproduced, nor may its contents be utilized or communicated, unless expressly permitted. Infringements will result in compensation for damages. The software described in this document is licensed and may only be used and copied in accordance with the license conditions.
All rights reserved.

Disclaimer

We have checked the contents of this publication for conformity with the hardware and software described. However, deviations cannot be ruled out, so that we cannot guarantee complete conformity. The information in this publication is checked regularly. Corrections and additions will be made in the following version. We are grateful for any suggestions for improvement.

Subject to technical changes

Table of content

Table of contents	3
Safety regulations and installation instructions.....	4
Classification of the safety instructions	5
General information	6
Introduction	7
1.0 General information for installation and operation	8
2.0 Technical features	9
3.0 ATEX relevant data	10
4.0 Error states and error signaling	11
5.0 Technical data	12
5.1 Configuration protocol	16
5.2 Calculation of the maximum line resistance for the analog output	17
5.3 Block diagram	19
5.4 Nameplate	19
5.5 Circuit board with connections	20
5.6 Terminal assignment	20
5.7 Jumper settings	21

Safety regulations and instructions

Follow the instructions for installation:



Note: Installation, operation and maintenance may only be carried out by qualified personnel.

The applicable safety guidelines (including the national safety guidelines), accident prevention regulations and general technical regulations must be observed when installing and operating the appliance.



Note: The circuits in the appliance must not be accessed.

Do not repair the appliance yourself, but replace it with an equivalent appliance. Repairs may only be carried out by the manufacturer.



Note: The device is suitable for protection class IP20 if:

- It is installed outside potentially explosive atmospheres
- The environment is clean and dry

Install the device in a suitable housing with a suitable degree of protection in accordance with IEC/EN 60079-0 to protect it from mechanical and electrical damage.

The safety-relevant data can be found in the operating instructions and in the ATEX certificate (EU type examination certificate or other certificates, if necessary).

Safety regulations for installation in potentially explosive atmospheres and Regulations for intrinsically safe circuits:



Warning: Explosion hazard

When carrying out measurements on the intrinsically safe side, the relevant regulations regarding the connection of intrinsically safe electrical equipment must be observed.

Only use approved devices for use in intrinsically safe circuits.



Warning: Explosion hazard

If the device has previously been used in non-intrinsically safe circuits, it must not be used for intrinsically safe circuits may no longer be used.

Clearly mark the device as no longer intrinsically safe.

Installation in areas with a risk of dust explosions:



Warning: Explosion hazard

The appliance is not approved for installation in areas where there is a risk of dust explosions.

Only interconnect intrinsically safe circuits in potentially explosive dust in zones 20, 21 or 22 if the equipment connected to these circuits is approved for this zone (e.g. category 1D, 2D or 3D).

Classification of the instructions

This manual contains instructions that you must observe for your personal safety and to prevent damage to property. The instructions are highlighted by a warning triangle and shown as follows, depending on the degree of danger.



DANGER

means that death or serious bodily injury will occur, if the appropriate precautions are not taken.



WARNING

means that death or serious bodily injury may occur, if the appropriate precautions are not taken.



CAUTION

with a warning triangle means that minor bodily injury may occur, if the appropriate precautions are not taken.

CAUTION

without a warning triangle means that material damage may occur, if the appropriate precautions are not taken.



ATTENTION

means that an undesirable result or condition may occur, if the corresponding notice is not observed.



NOTE

is important information about the product, the handling of the product or the part of the documentation to which particular attention is drawn, and compliance with which is recommended.

In addition to these instructions in this publication, the generally applicable safety and accident prevention regulations must be observed.

If the information contained in this brochure is not sufficient in any case, our telephone service is at your disposal for further information.

Please read this document carefully before installation and commissioning.

CE mark

This product complies with the specifications of the EMC Directive 2004/108/EC and the Low Voltage Directive 2006/95/EC.

General information

This appliance has left the factory in a technically safe condition. In order to maintain this condition and to ensure safe operation of the appliance, the instructions and warnings given in these operating instructions must be observed by the user.

NOTE

For reasons of clarity, these instructions do not contain all detailed information on all types of the product and cannot take into account every conceivable case of installation, operation or maintenance.

Should you require further information, or should particular problems arise that are not covered in sufficient detail in the instructions, you can request the necessary information by telephone.

Furthermore, we would like to point out that the contents of the instructions are not part of a previous or existing agreement, promise or legal relationship or are intended to change these. All obligations of Mütec Instruments GmbH arise from the respective purchase contract, which also contains the complete and solely valid warranty provisions. These contractual warranty provisions are neither extended nor limited by the explanations in the instructions.

The content reflects the technical status at the time of printing. We reserve the right to make technical changes in the course of further development.

WARNING

Devices with "intrinsic safety" type of protection lose their approval as soon as they have been operated on circuits that do not comply with the values specified in the test certificate. The correct and safe operation of this appliance requires proper transportation, storage, installation and assembly as well as careful operation and maintenance. The appliance may only be used for the purposes specified in these operating instructions.

DISCLAIMER

All modifications to the appliance, unless expressly mentioned in the operating instructions, are the responsibility of the user.

Qualified PERSONNEL

are persons who are familiar with the installation, assembly, commissioning and operation of the product and who have the appropriate qualifications for their work, e.g:

- Training or instruction or authorization to operate and maintain devices/systems in accordance with the safety engineering standard for electrical circuits, high pressures and aggressive and hazardous media.
- For devices with explosion protection: training or instruction or authorization to carry out work on electrical circuits for potentially explosive systems.
- Training or instruction according to the standard of safety engineering in the care and use of appropriate safety equipment.

CAUTION


Electrostatic sensitive modules can be destroyed by voltages that are far below the threshold of human perception. These voltages already occur when you touch a component or electrical connections of an assembly without being electrostatically discharged. The damage that occurs to a module due to an overvoltage cannot usually be detected immediately, but only becomes noticeable after a long period of operation



Introduction

MTP200ia-TE-SIL, MTP200ib-TE-SIL

Universal transmitter according to DIN EN 61508 - SIL2

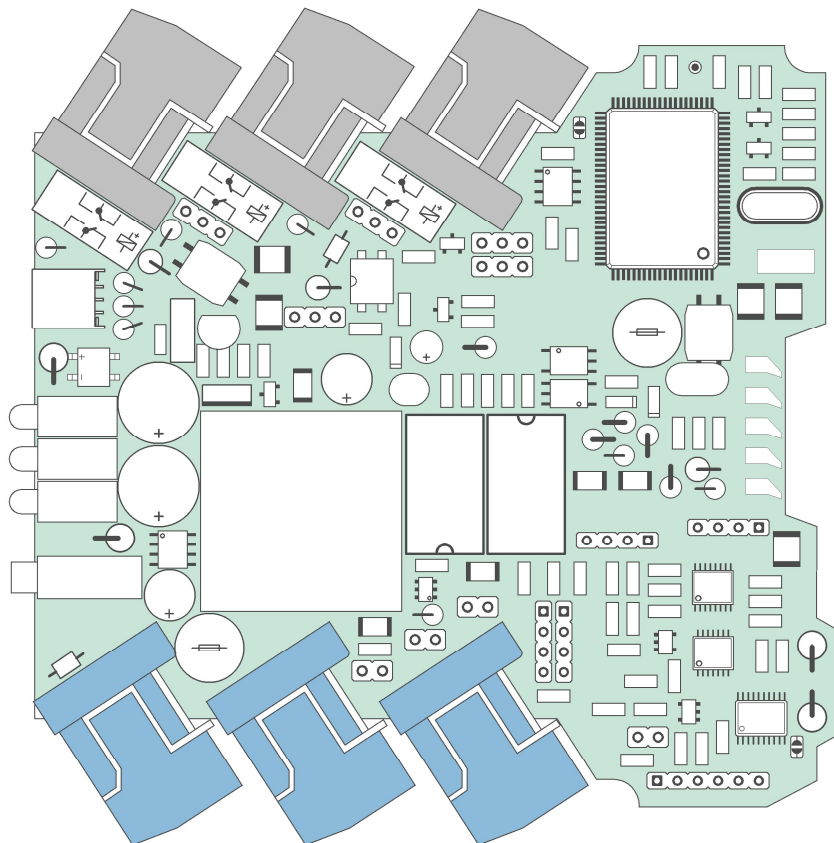

Performance features:

- ◆ DuoTec® system (2 controllers with mutual monitoring)
- ◆ Failsafe technology for self-monitoring
- ◆ 4 A/D converters (24-bit, 12-bit and 10-bit)
- ◆ 1 D/A converter (15-bit)
- ◆ 5 Self-monitoring circuits
- ◆ 4 galvanically isolated alarm outputs (3x relay contact, 1x transistor)
- ◆ 4 intrinsically safe measuring signal inputs[Ex ia/ib] IIC
- ◆ 20-bit measuring signal resolution
- ◆ 0.05 °C max. resolution for Pt100 measurement
- ◆ 1 analog output for constant current or voltage
- ◆ 1 galvanically isolated RS232 interface
- ◆ 1 galvanically isolated RS485 interface
- ◆ 24V AC/DC Power

1.0 General information for installation and operation

Labeling according to Directive 2014/34/EU:

Checkpoint _____ **0158**  **II (2) G**

Device group _____

Associated equipment with external circuits
for connection to category 2 devices _____

for explosive mixtures of air and flammable substances
Gases, vapors or mists _____

Marking of the type of protection:

_____ **[Ex ia Ga] IIC**

associated electrical operating
Medium according to European standard _____

Type of protection _____

EPL (Equipment Protection Level) _____

Equipment group _____

Safety instructions

The appliance must be taken out of operation and secured against unintentional operation if it must be assumed that safe operation is no longer possible. Reasons for this assumption may be

- Visible damage to the device
- Failure of the electrical function
- Longer storage at temperatures above 85 °C
- Heavy transportation stress

Before the appliance is put back into operation, a professional routine test must be carried out in accordance with DIN EN 61010, Part 1. This test should always be carried out by the manufacturer. Repair work on Ex devices may only be carried out in accordance with §9 of the Ex Ordinance (Elex V).

Devices with intrinsically safe circuits must never be operated on non-intrinsically safe circuits. If Ex devices are to be operated on non-intrinsically safe circuits, they must be specially labeled and the Ex markings must be removed so that these devices are not used for intrinsically safe circuits at a later date. Subsequent testing of the devices for compliance with the conditions for explosion protection is only possible at a disproportionately high cost, even for the manufacturer, and is therefore generally rejected.

Intended use

The universal transmitter MTP200i..-TE-SIL is used for precise temperature measurement with Pt100 sensor or thermocouple in hazardous areas. Two additional inputs for intrinsically safe current or voltage signals also extend the application of the module as an isolating amplifier.

The Pt100/resistance transmitter input at terminals KL21, KL22, KL23 and KL24 and, in parallel, the temperature reference junction input at terminals KL19 and KL20 correspond to the "intrinsic safety" type of protection of category "ia" or "ib".

The thermocouple/mV input at terminals KL17 and KL18 corresponds to the "intrinsic safety" type of protection of category "ia" or "ib".

The +/-20mA input at terminals KL13 and KL14 and the +/-10V input at terminals KL14 and KL15 correspond to the "intrinsic safety" type of protection of category "ia" or "ib".

The maximum permissible ambient temperature range of -20 °C to +60 °C must not be exceeded or undershot.

The universal measuring transducer MTP200i..-TE-SIL is an associated piece of electrical equipment with type of protection [Ex ia] IIC or [Ex ib] IIC and must always be operated outside potentially explosive atmospheres. Only the measuring and input circuits listed above may be routed into the hazardous area and connected to certified intrinsically safe circuits. Before commissioning, proof of intrinsic safety must be provided for the correct interconnection of an MTP200i..-TE-SIL circuit with the circuit of the connected equipment, including the cables.

The EC type examination certificate and the provisions of EN 60079-14:2014 must be observed.

Installation and commissioning

The universal measuring transducer MTP200i..-TE-SIL must be installed in such a way that the clearances from bare parts of intrinsically safe circuits to the metallic housing parts are at least 3 mm and to the bare parts of non-intrinsically safe circuits at least 6 mm.

Connecting parts for the external intrinsically safe circuits must be arranged in such a way that the bare parts are at least 50 mm away from connecting parts or bare conductors of non-intrinsically safe circuits in accordance with EN 60079-11.

The terminal assignments of the mounting rail housing with the intrinsically safe circuits and the non-intrinsically safe circuits are clearly marked on the rating plate. In addition, the 4-pole terminals of the intrinsically safe circuits are blue.



For safe operation, a protective conductor connection must be established with terminal KL16 or with terminal KT-B3 on the top-hat rail bus connector in order to ensure permanent integration into the equipotential bonding.

Assembly/disassembly, installation, operation and maintenance may only be carried out by qualified personnel as defined by the automation industry in compliance with the relevant regulations and the MTP200i..-TE-SIL operating instructions. The technical data and connected loads must be observed during installation.

2.0 Technical features

Equipped with two mutually monitoring 16-bit controllers (DuoTec® system), the measuring transducer meets all safety requirements in accordance with EN 61508 for SIL2 with additional measures (failsafe technology). Configuration, parameterization and calibration can be carried out quickly, easily and clearly via the RS232/RS485 interface using the WINSMART® PC program. As proof of the selected device parameters, these can be documented using the WinSmart program under *Save/Print configuration*.

- Master/slave controller according to the DuoTec technology®
- Intrinsically safe measurement inputs of protection class [Ex ia] IIC or [Ex ib] IIC
- Thermocouple measurement input with internal or external Pt100 reference junction
- Continuous monitoring of the loop resistance in the mV measuring circuit
- Pt100 measuring input in 2-, 3- and 4-wire circuit

- Potentiometer/resistance transmitter measuring input in 2-, 3- and 4-wire circuit
- mV measurement input for +/-70 mV
- Voltage measurement input for +/-10 V
- Current measurement input for +/-20 mA
- Analog output for 0/4-20 mA or 0/2-10 V
- Output signal monitoring by reading back the mA value
- 2 relay outputs for limit value monitoring and/or maintenance requirement message
- 1 passive short-circuit-proof 50mA transistor output
- 1 relay output for the maintenance requirement signal
- COM interface connection on the front for online access
- Galvanically isolated RS232 and RS485 interface
- 24V AC/DC supply with undervoltage cut-off

3.0 ATEX relevant data

Ex certificate		BVS 08 ATEX E 043 1st addendum		
		II (1) G [Ex ia Ga] IIC for MTP200ia-TE-SIL		
		II (2) G [Ex ib Gb] IIC for MTP200ib-TE-SIL		
Conformity	EN IEC 60079-0:2018		General requirements	
	EN 60079-11:2012		Intrinsic safety "i"	
Supply circuit (terminals 3 and 4 or contact KT-B4 and KT-B5)				
Rated voltage		DC	19 ... 30	V
Rated voltage		AC	18 ... 28	V
max. voltage	To	AC/DC	250	V
Non-intrinsically safe RS485 interface circuit (contact KT-B1 and KT-B2)				
Non-intrinsically safe RS232 interface circuit (front socket connection)				
Rated voltage		DC	6	V
Rated current			100	mA
max. voltage	To	AC/DC	48	V
Non-intrinsically safe relay contact circuits (terminals 1 and 2, 5 and 6, 9 and 10)				
Switching voltage		DC	30	V
Switching current			1	A
Or				
Switching voltage		AC	125	V
Switching current			0,5	A
max. voltage	To	AC/DC	125	V
Non-intrinsically safe digital output circuit (terminals 7 and 8)				
Rated voltage		DC	28	V
Rated current			50	mA
max. voltage	To	AC/DC	125	V
Non-intrinsically safe analog output circuit (terminals 11 and 12)				
Rated voltage		DC	20	V
Rated current			50	mA
max. voltage	To	AC/DC	125	V
Intrinsically safe Pt100/resistance transmitter input circuit (terminals 21, 22, 23 and 24)				
Intrinsically safe temperature reference junction input circuit (terminals 19 and 20)				
Tension	Uo	DC	12	V
Amperage	Io		6.5	mA
Performance	Po		10	mW
max. external capacity	Co		1.2	µF
max. external inductance	Lo		700	mH

Intrinsically safe thermocouple/mV input circuit (terminals 17 and 18)

Tension	U _o	DC	6 V
Amperage	I _o		1 mA
Performance	P _o		2.5 mW
max. external capacity	C _o		10 µF
max. external inductance	L _o		1000 mH
for connecting an intrinsically safe circuit with the following maximum values:			
Tension	U _i	DC	10 V
Effective internal capacity	C _i		240 nF
Effective internal inductance	L _i	negligible	

Intrinsically safe +/-20mA input circuit (terminals 13 and 14)

for connecting an intrinsically safe circuit with the following maximum values:

Tension	U _i	DC	30 V
Amperage	I _i		110 mA
Performance	P _i		700 mW
Effective internal capacity	C _i	negligible	
Effective internal inductance	L _i	negligible	

Intrinsically safe +/-10V input circuit (terminals 14 and 15)

Tension	U _o	DC	6 V
max. external capacity	C _o		10 µF
for connecting an intrinsically safe circuit with the following maximum values:			
Tension	U _i	DC	30 V
Amperage	I _i		110 mA
Performance	P _i		700 mW
Effective internal capacity	C _i	negligible	
Effective internal inductance	L _i	negligible	

Ambient temperature range

T _{amb}	-20 °C to +60 °C
------------------	------------------

4.0 Error states and error signaling

No.	Source of error/ Cause of error	Alarm LED	Analog output in case of error (programmable)	Alarms (program mizable)	Recommissioning after troubleshooting	Remark
1	EEPROM: Checksum faulty	Permanent light	Alarm value or Instantaneous value	lim-prio, to, from limit	MSK200 must be reconfigured, parametrized and calibrated	Parameter table in RAM is loaded with default values
2	Master controller: Error in the RAM/EPROM Memory	Permanent light	Alarm value or frozen Value	lim-prio, on from limit	automatically (after system reset)	Parameter set or program damaged
3	Slave controller: Communication, RAM or CPU Defective	Permanent light	Alarm value or Frozen value	lim-prio, on from limit	automatically	
4	Slave controller: 5V supply faulty	Permanent light	Alarm value or Instantaneous value	lim-prio, on from limit	automatically	at ≥ 4 % off softening from the Reference value
5	Master controller: 3V3 supply faulty	Permanent light	Alarm value or Instantaneous value	lim-prio, on from limit	automatically	at ≥ 4 % off softening from the Reference value

6	Analog output: Signal deviation	Permanent light	Alarm value or Instantaneous value	lim-prio, on from limit	automatically	parameterizable: from $\geq 0.2\%$
7	A/D converter: Signal deviation	Permanent light	Alarm value or Instantaneous value	lim-prio, on from limit	automatically	parameterizable: from $\geq 0.2\%$
8	mA measuring current circuit: MIN signal under-transgression	Permanent light	Alarm value or frozen Value	lim-prio, on from limit	automatically	parameterizable: from 0 mA
9	mA measuring current circuit: MAX signal over-transgression	Permanent light	Alarm value or Frozen value	lim-prio, on from limit	automatically	parameterizable: up to 22 mA
10	Alarm outputs Relay contact Rel1, Rel2 or Rel3 defective	Permanent light	Alarm value or Instantaneous value	lim-prio, on from limit	automatically	Parallel contact of the relay serves for reference !



In general, the alarm for maintenance requirements, signaled by the alarm LED and relay 3, remains permanently on in the event of an existing fault. The source of the fault is displayed in the diagnostics manager as the current fault and in the fault memory.

A temporary error that is no longer present is signaled by a flashing alarm LED on the front of the device and in the error memory in the diagnostics manager.

Every fault is therefore recorded and the diagnostic manager can differentiate between a fault that is present and one that is no longer present.

5.0 Technical data

ANALOG INPUTS (AE1 ... AE4)

A 1st order filter of (0.1 - 99.9)s can be parameterized for the measurement inputs!

mA measurement input AE1

Measuring span: -22 +22 mA, freely configurable
Input resistance: 45 Ω

V measuring input AE2

Measuring span: -11 +11 V, freely configurable
Input resistance: 100 k Ω

Pt100 resistance thermometer (DIN IEC 751) AE3

Connection: 2-, 3- and 4-Lt. technology
Measuring range: -200 °C to +800 °C
Measuring span: min. 5 °C, max. 1000 °C
Measuring current: 1 mA
Measured value resolution: 0,01 K
Permissible line resistance: $\leq 100\ \Omega$

Resistance remote sensor/potentiometer (DIN 43822) AE3

Connection:	2-, 3- and 4-Lt. technology
Measuring range:	0 ... 600 Ω or 0 ... 5000 Ω
Measuring span:	min. 3 Ω , max. 600 or 5000 Ω
Measuring current:	1/0.2 mA
Measured value resolution:	0,01/0,1 Ω
Permissible line resistance:	$\leq 100 \Omega$

mV measurement input AE4

Measuring range:	-70 +70 mV, freely configurable
Input resistance:	>1 M Ω
Max. Line resistance:	2000 Ω (loop resistance)

Thermocouples (DIN IEC 584) AE4

Cold junction compensation:	internal/external with Pt100
-----------------------------	------------------------------

Type	Start[°C]	End[°C]	Accuracy[°C]	Measuring span[°C]
B	100	1800	0,4	$\geq 20 / \leq 1800$
C	0	2300	0,5	$\geq 20 / \leq 2300$
D	0	2300	0,5	$\geq 20 / \leq 2300$
E	-200	1000	0,2	$\geq 10 / \leq 1200$
J	-200	1000	0,2	$\geq 10 / \leq 1200$
K	-200	1200	0,2	$\geq 10 / \leq 1400$
R	0	1700	0,3	$\geq 15 / \leq 1700$
S	0	1700	0,3	$\geq 15 / \leq 1700$
T	-200	400	0,2	$\geq 10 / \leq 600$

ANALOG OUTPUT (AA)

Parameterizable 1st order filter from (0.1 - 9.9)s!

Galvanic isolation between input, analog output and power supply!

	Constant current	Voltage
Max. Range:	0...22 or 22...0 mA	0...11 or 11...0 V
Standard range:	0/4-20 mA	0/2-10 V
Load:	max. 500 Ω at 20 mA	min. 50 k Ω m
Accuracy:	0.02 % of the final value	0.02 % of the final value
Load influence:	< 0,005 %	0.5 % with $R_L=100 \text{ k}\Omega$
Rise time:	< 150 ms	< 150 ms

CONTACT OUTPUTS (REL1, REL2), TRANSISTOR OUTPUT (DA)

For devices with intrinsically safe circuits, the contact and transistor outputs must only be used for devices with operating voltages below 250 V:

The alarm statuses are indicated by yellow LEDs!

Number of alarms:	3 independently adjustable limit values
Setting:	Physical value in the WINSMART program®
Accuracy:	like measurement accuracy
Alarm type:	configurable as desired
Alarm output:	2 relay contacts and 1 transistor output
Alarm delay:	freely configurable from 0 ... 9,9 s
Switching hysteresis:	freely configurable from 0 ... 99,9 %
Operating mode:	Open-circuit or closed-circuit principle
Alarm function:	Input signal monitoring and maintenance requirement message

Contact outputs REL1/REL2

Contact:	Normally closed or normally open contact (according to jumper position)
Switching capacity:	max. 62.5 VA or max. 30 W
Switching voltage:	max. 125 V AC or 110 V DC
Switching current:	max. 1 A
Minimum contact voltage:	10 mVDC
Minimum contact current:	10 µA
Contact material:	AG Pd + 10 µAu
Relay type:	according to IEC 947-5-1 or EN60947

Transistor output DA

Switching power:	< 1,4 W
Switching voltage:	< 28 VDC
Switching current:	< 50 mA

CONTACT OUTPUT (REL3) for MAINTENANCE REPORTING

For devices with intrinsically safe circuits, only devices with operating voltages below 250 V may be connected via the relay contact!

The alarm status is indicated by a red LED!

Operating mode:	closed-circuit current principle
Contact:	closed in good condition
Alarm function:	Maintenance requirement message
Contact position:	closed in good condition
Switching capacity:	max. 62.5 VA or max. 30 W
Switching voltage:	max. 125 V AC or 110 V DC
Switching current:	max. 1 A
Minimum contact voltage:	10 mVDC
Minimum contact current:	10 µA
Contact material:	AG Pd + 10 µAu
Relay type:	according to IEC 947-5-1 or EN60947

INTERFACES (COM, RS485)

Galvanic isolation of the COM and RS485 from the power supply and all other circuit components!

RS232/COM:	via front socket with Mütec interface cable
RS485:	Half-duplex, without termination
Baud rate:	9600 bps
Device address:	1-248

SUPPLY VOLTAGE

Supply voltage display:	green LED signals good status
Supply voltage range:	19 ... 30 VDC or 18 ... 28 VAC

Power consumption

Us = 24 VDC	1.2 W (4 mA in analog output)
Us = 24 VDC	1.5 W (20 mA in analog output)

GENERAL DATA

Measurement accuracy

Maximum:	< 0.04 % of the final value
Typical:	< 0.02 % of the final value

Temperature coefficient	
Maximum:	< 0,01 %/K
Typical:	< 0,005 %/K
Galvanic isolation	
Input/output/supply:	300 Vrms (rated insulation voltage, overvoltage protection) category II, pollution degree 2, safe isolation according to EN 61010, EN 50178); 2.5 kV AC test voltage (50 Hz, 1 min.);
Input/output:	375 V (peak value according to EN 60079-11)
Input/supply:	375 V (peak value according to EN 60079-11)
Ambient conditions	
Permissible temperature:	-20 °C ... +60 °C
Storage/transport:	-30 °C ... +80 °C
Perm. humidity (during operation):	10 % ... 95 % r.h. without condensation
Electrical connection	
KL-1 to KL-12:	Screw connector/gray with 2.5 mm ²
KL-13 to KL-24:	Screw connector/blue with 2.5 mm ²
KL-B1 to KL-B5:	TBUS connector with 2.5 mm ²
Housing	
Material:	PBT
Protection class:	IP20
Flammability class:	V0 according to UL
Dimensions (WxLxH):	22.5 mm x 114.5 mm x 99 mm without terminals
Weight:	250 g
Design:	Terminal housing for DIN rail mounting
Mounting/installation position:	any
Measures for self-monitoring	
mV/TC measurement input:	1 monitoring measuring circuit with adjustable tolerance + Loop resistance measurement with adjustable limit value
Resistance measurement input:	1 monitoring measuring circuit with adjustable tolerance
Analog output :	1 monitoring measuring circuit with adjustable tolerance
Supply voltages:	2 monitoring measuring circuits
Sensor/control breakage:	1 monitoring measuring circuit
Relay (REL1 ... REL3):	indirect contact monitoring
Maintenance required:	Continuous light of the red LED and REL3 contact open

A maintenance requirement signal is always issued by the REL3 relay, which is operated according to the closed-circuit principle. The relay contact, which is closed in the good state, offers the option of series connection with other REL3 contacts of other devices and thus collective alarm monitoring. In addition, relays REL1 and REL2 as well as transistor outputs DA1 and DA2 can also be involved in alarm signaling.

CONFORMITY

Ex directive (ATEX):	EN IEC 60079-0:2018, EN 60079-11:2012, EN 60079-26:2015
EMC Directive 2004/108/EC:	EN 61000-6-2, EN 61000-6-4, EN 61326-1
Functional safety:	SIL 2 according to IEC 61508/61511

ASSEMBLY

The appliance may only be installed outside a potentially explosive atmosphere!


The ME-MAX housing can be combined with a 5-pole TBUS connector/ DIN rail connector. The RS485 interface and the supply voltage can be conveniently wired through via the TBUS connector snapped into the top-hat rail. The TBUS connection is set up automatically in the grid of the devices involved. Time-consuming pre-planning or reworking of the TBUS connection on site is therefore a thing of the past.

Technical data:

5-pin connector with 3.81 mm pitch; 8 A maximum contact load;
High contact quality due to gold plating;
Mounting in NS 35/7.5 or NS 35/15 top-hat rails;



Only connect/disconnect the device to/from the TBUS connector without power!

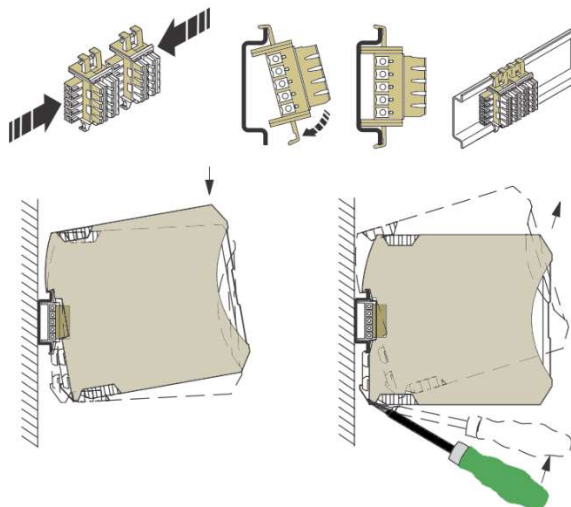

5.1 Configuration protocol

The WINSMART® command "Export configuration" can be used to create a log (xxx.csv) with all device parameters for each device. The specific identifiers are the device address, the tag no., the serial no. and the version no. of the software. All parameters for input, mA output and the relay/transistor outputs are documented. The desired behavior of the analog output, the two relays and the transistor output in the event of an error is also logged.

Gerätetyp	MTP200TE		
Firmwareversion	Apr 18		
Parameter CRC	7002		
Seriennummer	TEC2022-0012		
Geräte-TAG	12345678		
Modbusadresse	1		
Messeingang			
Messwert			
Sensor/Signal	mV-Signal (-35mV/70mV)		
Messbereichsanfang	-30 mV		
Messbereichsende	70 mV		
Filterzeit	0 s		
Physikalische Darstellung des Messwertes			
Bereichsanfang	-30 mV		
Bereichsende	70 mV		
Bereichsgrenze MIN	-31 mV		
Bereichsgrenze MAX	71 mV		
Messbereichsabbildung			
Bereichsanfang	4 mA		
Bereichsende	20 mA		
Filterzeit	0 s		
Ausgangssignal radizieren	Nein		
Begrenzung			
MIN-Begrenzung	3,6 mA		
MAX-Begrenzung	21 mA		
Alarmwert	22 mA		

Alarm 1 (Relais 1)				
Alarmwert		50 mV		
Alarmtyp	MAX-Alarm			
Funktion	Arbeitsstrom			
Hysterese		1 %		
Verzögerung		0,5 s		
Alarm 2 (Relais 2)				
Alarmwert		30 mV		
Alarmtyp	MAX-Alarm			
Funktion	Arbeitsstrom			
Hysterese		1 %		
Verzögerung		0,5 s		
Alarm 3 (Transistorausgang 1)				
Alarmwert		20 mV		
Alarmtyp	MAX-Alarm			
Funktion	Arbeitsstrom			
Hysterese		0,5 %		
Verzögerung		0,5 s		
Gradientenalarm - Zeitfenster		4 s		
Überwachungsmesskreis für maximale Toleranz:				
Thermoelement- und mV-Eing.		5 mV		
Widerstandseingang		5 % vom Fühlerstrom		
Analogausgang		5 % vom Nominalwert (=20mA/10V)		
Thermoelement-Sensor-/Leitu		1,5 kOhm		
Analogausgangs- und Alarmausgangs-Steuerung im Fehlerfall:				
Fehlerquellen	Analogausgang	Relais 1	Relais 2	Logik 1
mV-Messkreisüberwachung	Alarmwert	limit	limit	an
Widerstandsmesskreis	Alarmwert	limit	limit	an
Ausgangssignal	Alarmwert	aus	aus	aus
Sensor-/Leitungsbruch	Alarmwert	limit	limit	an
Relais 1, Relais 2, Relais 3	Alarmwert	limit	limit	an
Transistor-Output 1	Alarmwert	limit	limit	an
Interner Gerätefehler	Alarmwert	limit	limit	an

5.2 Calculation of the max. line resistance for the analog output

Data of the analog output (AA) for constant current:

Max. Range:	0...22 mA
Standard range:	0/4-20 mA
Load:	max. 500 Ohm at 20 mA
Accuracy:	0.02 % of the final value
Burden influence:	<0,005 %

The maximum load for the analog output is the sum of the resistances of the forward and return lines and the input resistance (shunt) of the downstream module:

$$R_{\text{load}} = 2 \times R_L + R_{\text{(shunt)}} \leq 500 \, \Omega$$

The following applies to the line resistance:

$$R_L = l \times \rho \times A^{-1} [\Omega]$$

$$\rho = 0.0178 \quad [\Omega \text{ mm}^2 \text{ m}^{-1}]$$

$$A = 0.25 \times d^2 \times \pi [\text{mm}^2]$$

Calculation of the maximum cable length (distance):

$$l = 0.5 (500 \, \Omega - R_{\text{(shunt)}}) \times \rho^{-1} \times A [\text{m}]$$


Cable lengths as a function of diameter and input resistance:

$R_{\text{(shunt)}}$ [Ω]	$L_{\text{(diameter)}}$ [mm]	$L_{\text{cross section}}$ [mm ²]	L_{length} [m]	L_{length} [km]
100	0,6	0,283	3179	3,18
	0,7	0,385	4325	4,33
	0,8	0,502	5640	5,64
	0,9	0,636	7146	7,15
	1,0	0,785	8820	8,82

$R_{\text{(shunt)}}$ [Ω]	$L_{\text{(diameter)}}$ [mm]	$L_{\text{cross section}}$ [mm ²]	L_{length} [m]	L_{length} [km]
200	0,6	0,283	2385	2,39
	0,7	0,385	3244	3,24
	0,8	0,502	4230	4,23
	0,9	0,636	5360	5,36
	1,0	0,785	6615	6,62

$R_{\text{(shunt)}}$ [Ω]	$L_{\text{(diameter)}}$ [mm]	$L_{\text{cross section}}$ [mm ²]	L_{length} [m]	L_{length} [km]
300	0,6	0,283	1590	1,59
	0,7	0,385	2163	2,16
	0,8	0,502	2820	2,82
	0,9	0,636	3573	3,57
	1,0	0,785	4410	4,41


5.3 Block diagram

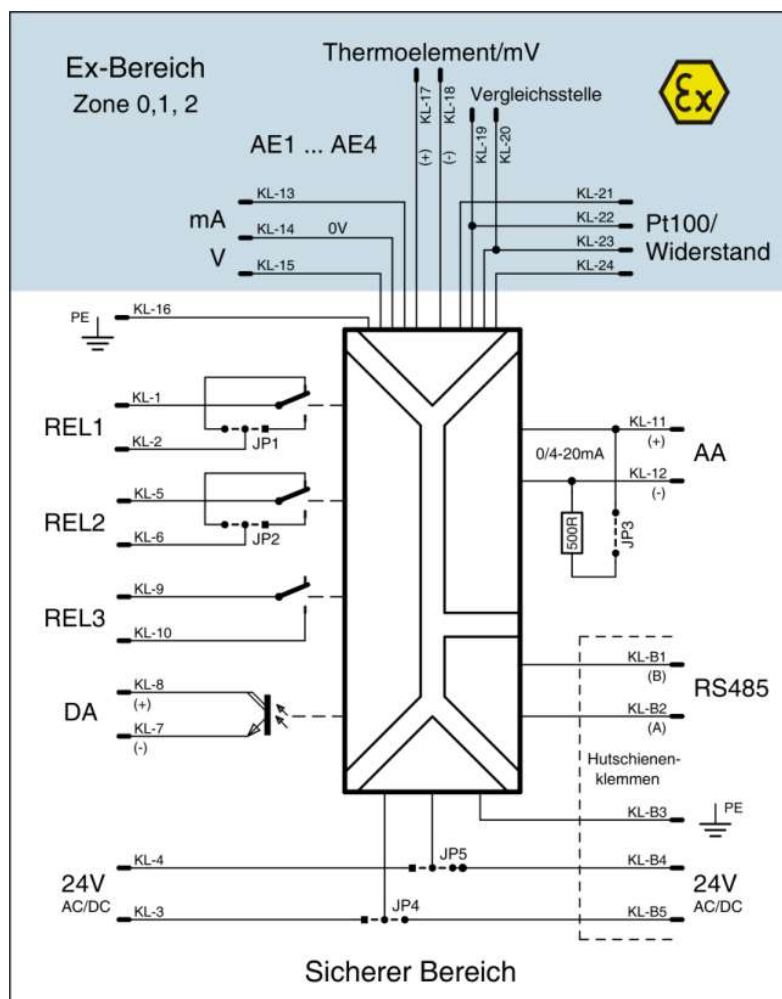

5.4 Nameplate

		Mütec Instruments GmbH Bei den Kämpfen 26 D-21220 Seevetal		KL1...KL4
Universalmessumformer MTP 200ia - TE		CE 0158 Ex II (1) G [Ex ia Ga] IIC BVS 08 ATEX E 043		KL5...KL8
T _{amb} : -20 bis +60°C Serien-Nr.: 1278		Firmware: 4.18 Date Code: 2351		KL9...KL12
Versorgung: 19-30 VDC / 18-28 VAC an KI 3 / 4 oder umschaltbar an KT-B4 / B5 (siehe Betriebsanleitung)		Relais1: KL1/2 Supply: KL3/4 Relais2: KL5/6 DA: KL7-8+ Relais3: KL9/10 AA: KL11+/12-		
KL21...KL24	Pt 100	Temp. VGS	TC/mV	V/mA-Eing.
KL19+20	KL17+18	KL13...15	KL16	PE

5.5 Board with connections

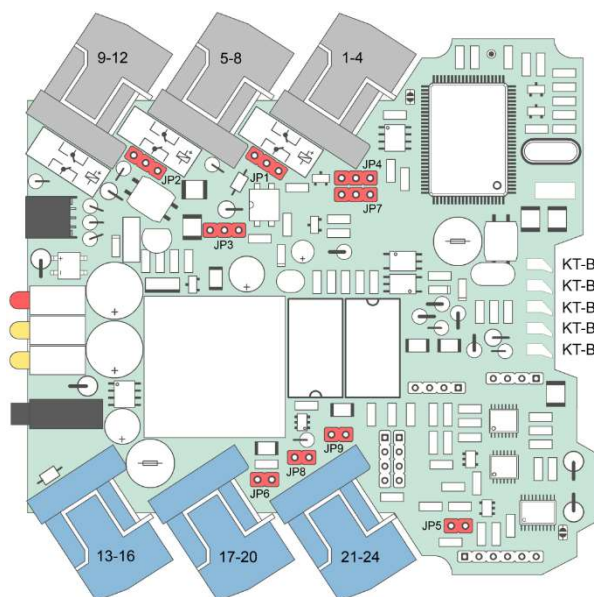

5.6 Terminal assignment

Eingang für Pt100, Widerstandsferngeber oder Potentiometer			
Klemme	2-Leiter	3-Leiter	4-Leiter
KL21 KL22 KL23 KL24			
Klemme	mA-Eingang oder V-Eingang	Klemme	Thermoelement/mV-Eingang
KL13 KL14 KL15		KL17 KL18 KL19 KL20	
Klemme	Analogausgang/mA	Klemme	Analogausgang/V (keine Konstantspannung)
KL11 KL12		KL11 KL12	
Klemme	Relaiskontaktausgänge	Klemme	Hilfsenergie
KL1 KL2 KL5 KL6 KL9 KL10		KL3 KL4 KL-B5 KL-B4 KL-B3 KL16	
Klemme	Digitalausgang	Klemme	RS485-Schnittstelle
KL8 KL7		KL-B2 KL-B1	



For the resistance measurement (input KL21 - KL24), the terminal block KL17 - KL20 must be removed!
The parallel connection of the resistance to be measured and the Pt100 in the terminal block would otherwise falsify the measured value.

5.7 Jumper settings

Jumpers JP1 and JP2:

Jumper JP1 for relay contact REL-1 or jumper JP-2 for relay contact REL-2 determines the contact function as normally closed or normally open.

Jumper JP3:

Jumper JP3 is used to switch the analog output from constant current (mA) to voltage (V).

Jumpers JP4 and JP7:

The jumpers JP4 and JP7 establish the connection to the supply voltage via the terminals KT-B4 and KT-B5 of the TBUS connector in the mounting rail or the terminal strip contacts KL3 and KL4.

Functions of jumpers JP5, JP6, JP8 and JP9:

Measurement input for:	JP-5	JP-6	JP-8	JP-9	Connections:
Voltage (V)	X	X	X	X	KL22 with KL23
Voltage (mV)	X	--	X	X	KL22 with KL23
Current (mA)	X	X	X	X	KL22 with KL23
Thermocouple with internal	X	--	X	X	
Thermocouple with external	X	--	X	X	
Thermocouple TVG in the thermostat	X	--	X	X	
Pt100/2-Lt. circuit	X	X	X		
Pt100/3-Lt. circuit	X	X	X	--	
Pt100/4-Lt. circuit	X	X	--	--	
Potentiometer/0-600 Ω 2-Lt. circuit	X		X	X	
Potentiometer/0-600 Ω 3-Lt. circuit	X	X	X	--	
Potentiometer/0-600 Ω 4-Lt. circuit	X	X	--	--	
Potentiometer/0-5000 Ω 2-Lt.	--		X	X	
Potentiometer/0-5000 Ω 3-Lt.	--	X	X	--	
Potentiometer/0-5000 Ω 4-Lt.	--	X	--	--	



X = Jumper closed
= Jumper open